

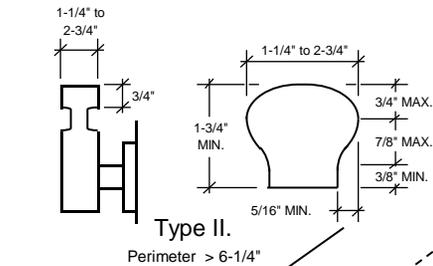
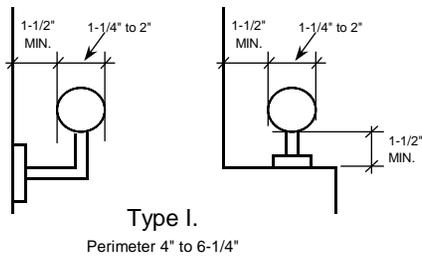


Stairs, Handrails and Guardrails Requirements N.T.S.

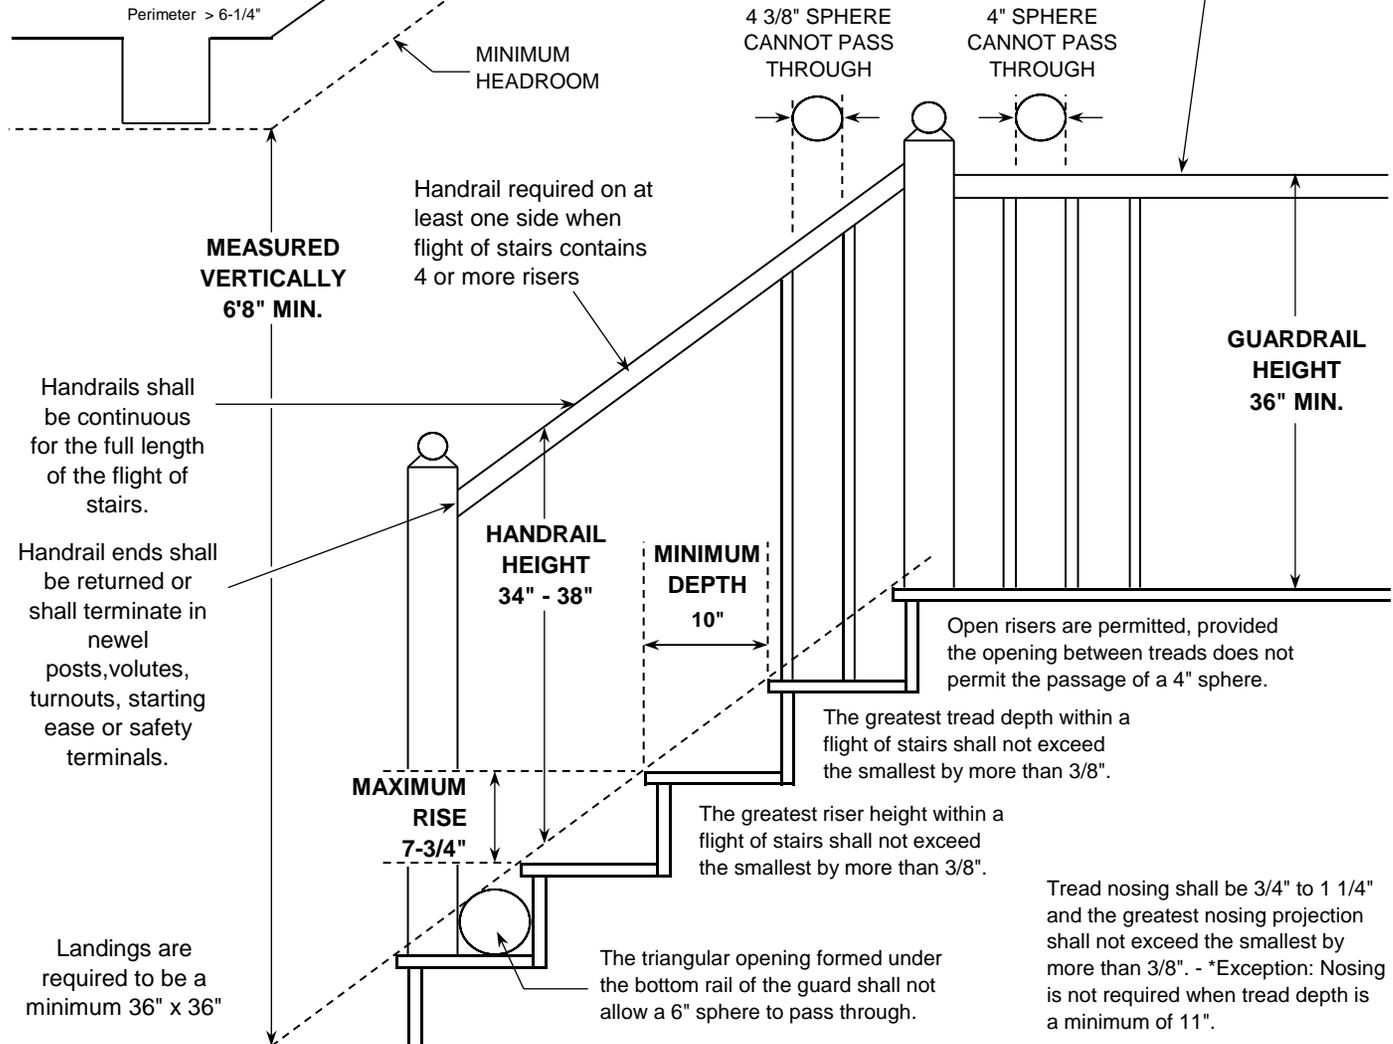

Guards are required when deck or landing is greater than 30" above the surface below. Guard in-fill shall withstand 50lbs./sq.ft. Guardsrails and Handrails shall withstand a 200lb. concentrated load.

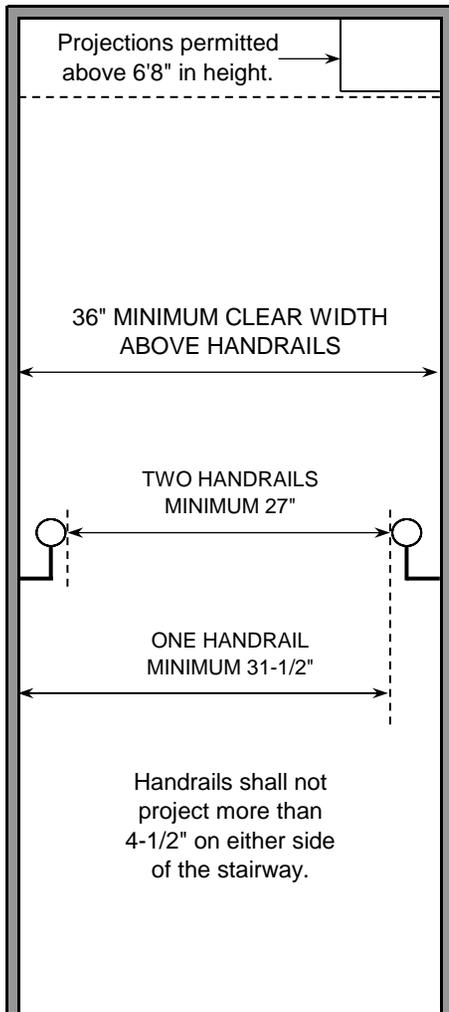

This information is extracted from the 2015 IRC, Sections 311 and 312. It is intended as a quick reference and does not include all requirements.